



by Schneider Electric

Installation Guide

Smart-UPS™ C 1000/1500 VA 120/230 Vac 2000/3000 VA 230 Vac Tower

Important Safety Messages

SAVE THESE INSTRUCTIONS - This manual contains important instructions that should be followed during installation and maintenance of the Power Management Unit, Service Bypass Unit and batteries.

Read the instructions carefully and look at the equipment to become familiar with the device before trying to install, operate, service or maintain it. The following special messages may appear throughout this document or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a Danger or Warning product safety label indicates that an electrical hazard exists that will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

DANGER

DANGER indicates a hazardous situation which, if not avoided, will result in death or serious injury.

WARNING

WARNING indicates a hazardous situation which, if not avoided, could result in death or serious injury.

CAUTION

CAUTION indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.

NOTICE

NOTICE is used to address practices not related to physical injury.

Safety and General Information

Inspect the package contents upon receipt. Notify the carrier and dealer if there is any damage.

Read the Safety Guide supplied with this unit before installing the UPS.

- Adhere to all local and national electrical codes.
- This UPS is intended for indoor use only.
- Do not operate this UPS in direct sunlight, in contact with fluids, or where there is excessive dust or humidity.
- Be sure the air vents on the UPS are not blocked. Allow adequate space for proper ventilation.
- The battery typically lasts for two to five years. Environmental factors impact battery life. Elevated ambient temperatures, poor quality utility power, and frequent short duration discharges will shorten battery life.
- Connect the UPS power cable directly to a wall outlet. Do not use surge protectors or extension cords.

Radio Frequency Warning

This product has been tested and found to be category C2 device. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment is likely to cause radio interference with some communication devices like TV, mobiles, audio equipments, radio receivers, etc. Generally this issue can be corrected by moving the equipment a little away from the UPS, however sometimes additional measures may have to be taken at user's expense.


Inventory

All models



(2)

Documentation CD x 1
PowerChute Software CD x 1




(1)



(1)


Installation Guide

1000/1500/2000/3000 VA 230 Vac models




(2)


2000/3000 VA 230 Vac models



(1)




(1)



(1)


Product Overview

1000/1500 VA 120 Vac models

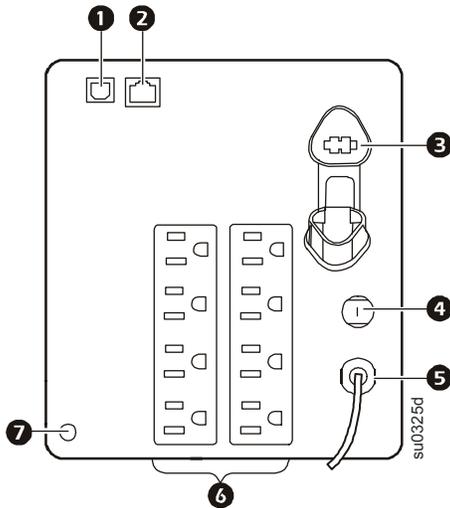


- 1 USB port
- 2 Serial data port
- 3 Battery connector

1000/1500 VA 230 Vac models

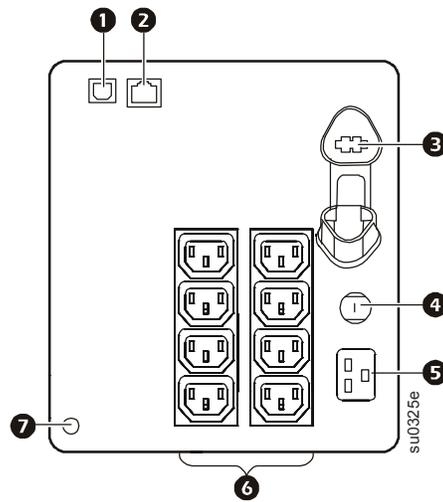


- 4 Circuit breaker/Overload protection
- 5 UPS input
- 6 Outlets
- 7 Chassis ground screw

2000 VA 230 Vac model

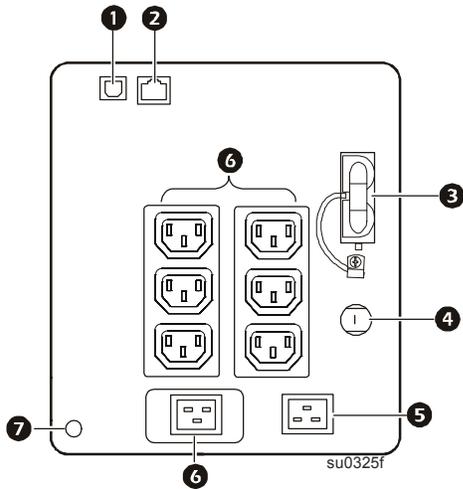


3000 VA 230 Vac model

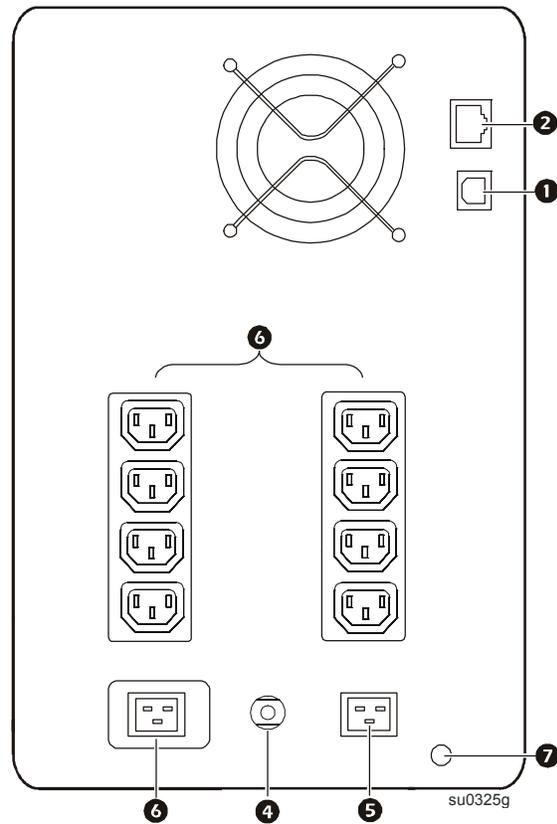

- 1 USB port
- 2 Serial data port
- 3 Battery connector
- 4 Circuit breaker/Overload protection
- 5 UPS input
- 6 Outlets
- 7 Chassis ground screw

Front panel features

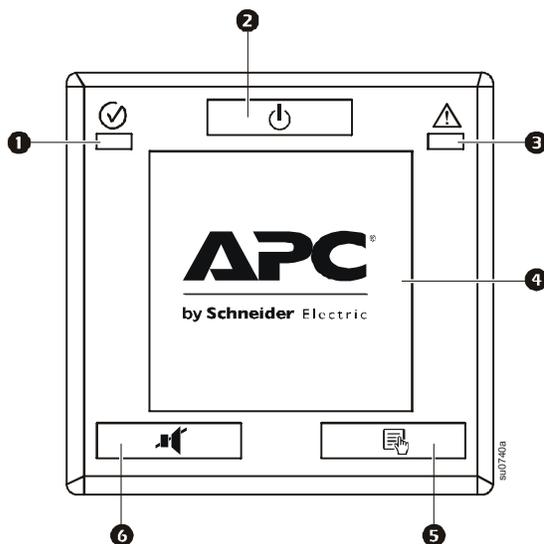


- 1 Online/On Battery LED
- 2 POWER ON/OFF button
- 3 Site Wiring Fault/Alert LED
- 4 Display interface
- 5 DISPLAY button
- 6 MUTE button


Installation

Connect the Battery


1000/1500 VA models

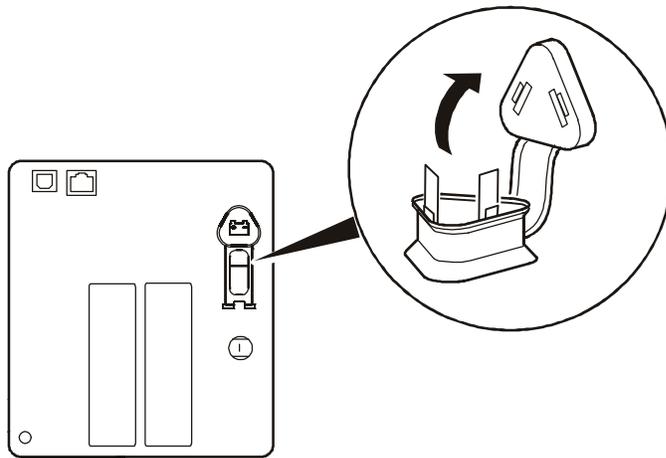

3000 VA model

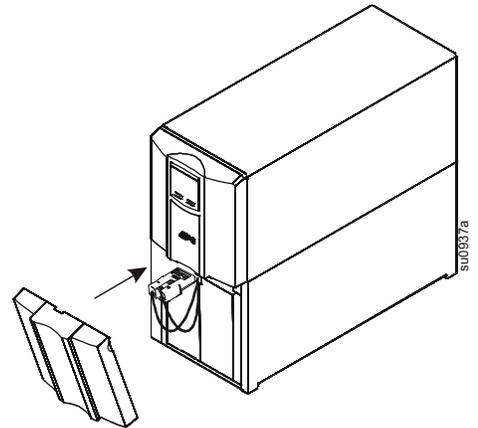

2000 VA model

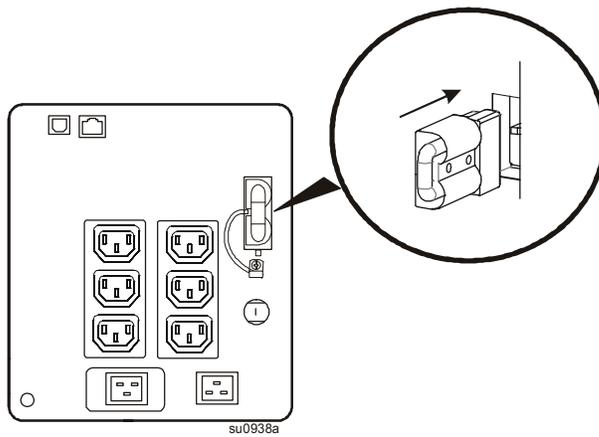


Connect equipment to the UPS and connect the UPS to utility power

⚠ CAUTION

RISK OF ELECTRIC SHOCK

- Adhere to all local and national electrical codes.
- Wiring must be performed by qualified electrician.
- Always connect the UPS to a grounded outlet.

Failure to follow these instructions can result in minor or moderate injury

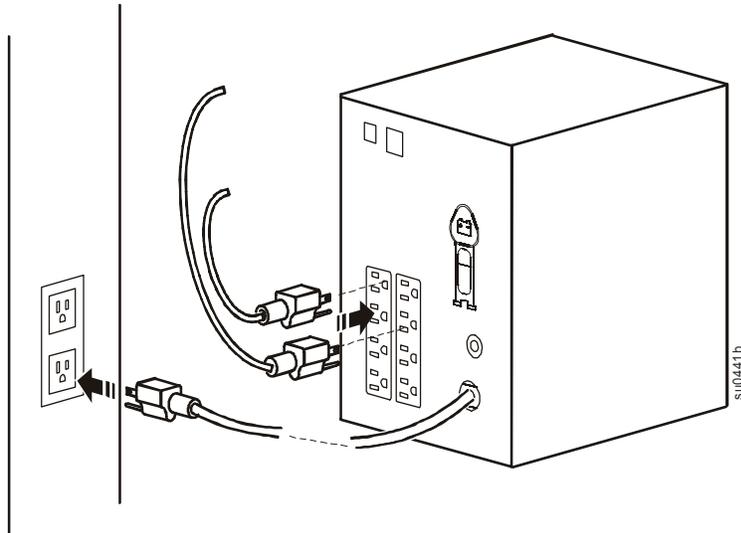

Select models are ENERGY STAR[®] qualified.

For more information on your specific model go to www.apc.com.